


Drinking Water Threatened by Sanford's Wastewater Plant

Sanford's wastewater plant discharges toxic PFAS and 1,4-dioxane upstream of the city's intake, which could threaten the drinking water of over 130,000 people.

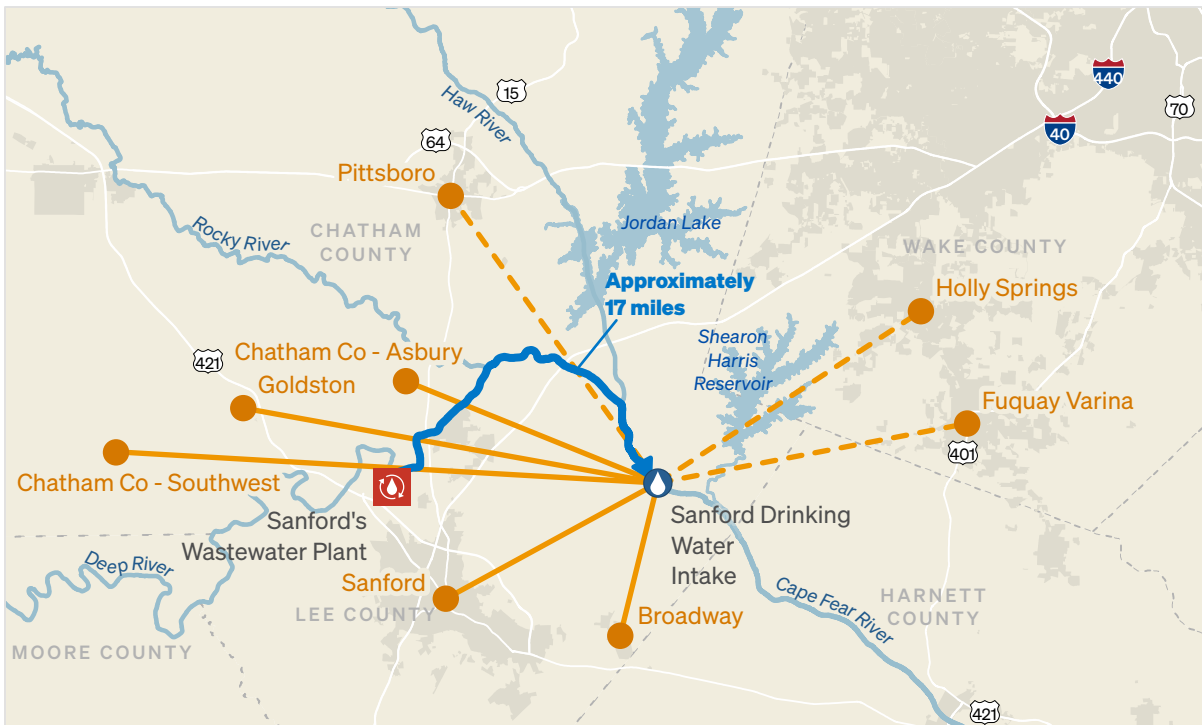

System Connections ● Public Water Supply System

— Existing

- - - Potential

Map Location



Author: Miller Cochran (mcochran@selcnc.org)

Last Updated: 10/17/2022

Sources: NCDEQ, NCDOT, USGS, Natural Earth

Note: Intake and facility outfall locations are approximate based on best available data

